

III piętro: P-5 3p.
puszka pcvt
LZH





IV	124/YDYp 2x1mm ²
III	143,23,24/3xYDYp 2x1mm ²
II	XTKH 5x4x0,6mm 143/YDYp 2x1mm ²

IV	124/YDYp 2x1mm ²
III	143,23,24/3xYDYp 2x1mm ²
II	XTKH 5x4x0,6mm 143/YDYp 2x1mm ²

IV	125/YDYp 2x1mm ²
III	144,21,22,25/4xYDYp 2x1mm ²
II	XTKH 5x4x0,6mm 144/YDYp 2x1mm ²

IV	143/YDYp 2x1mm ²
III	136,41,42,48/4xYDYp 2x1mm ²
II	136,39÷43/6xYDYp 2x1mm ²
I	XTKH 5x4x0,6mm

IV	143/YDYp 2x1mm ²
III	136,41,42,48/4xYDYp 2x1mm ²
II	136,39÷43/6xYDYp 2x1mm ²
I	XTKH 5x4x0,6mm

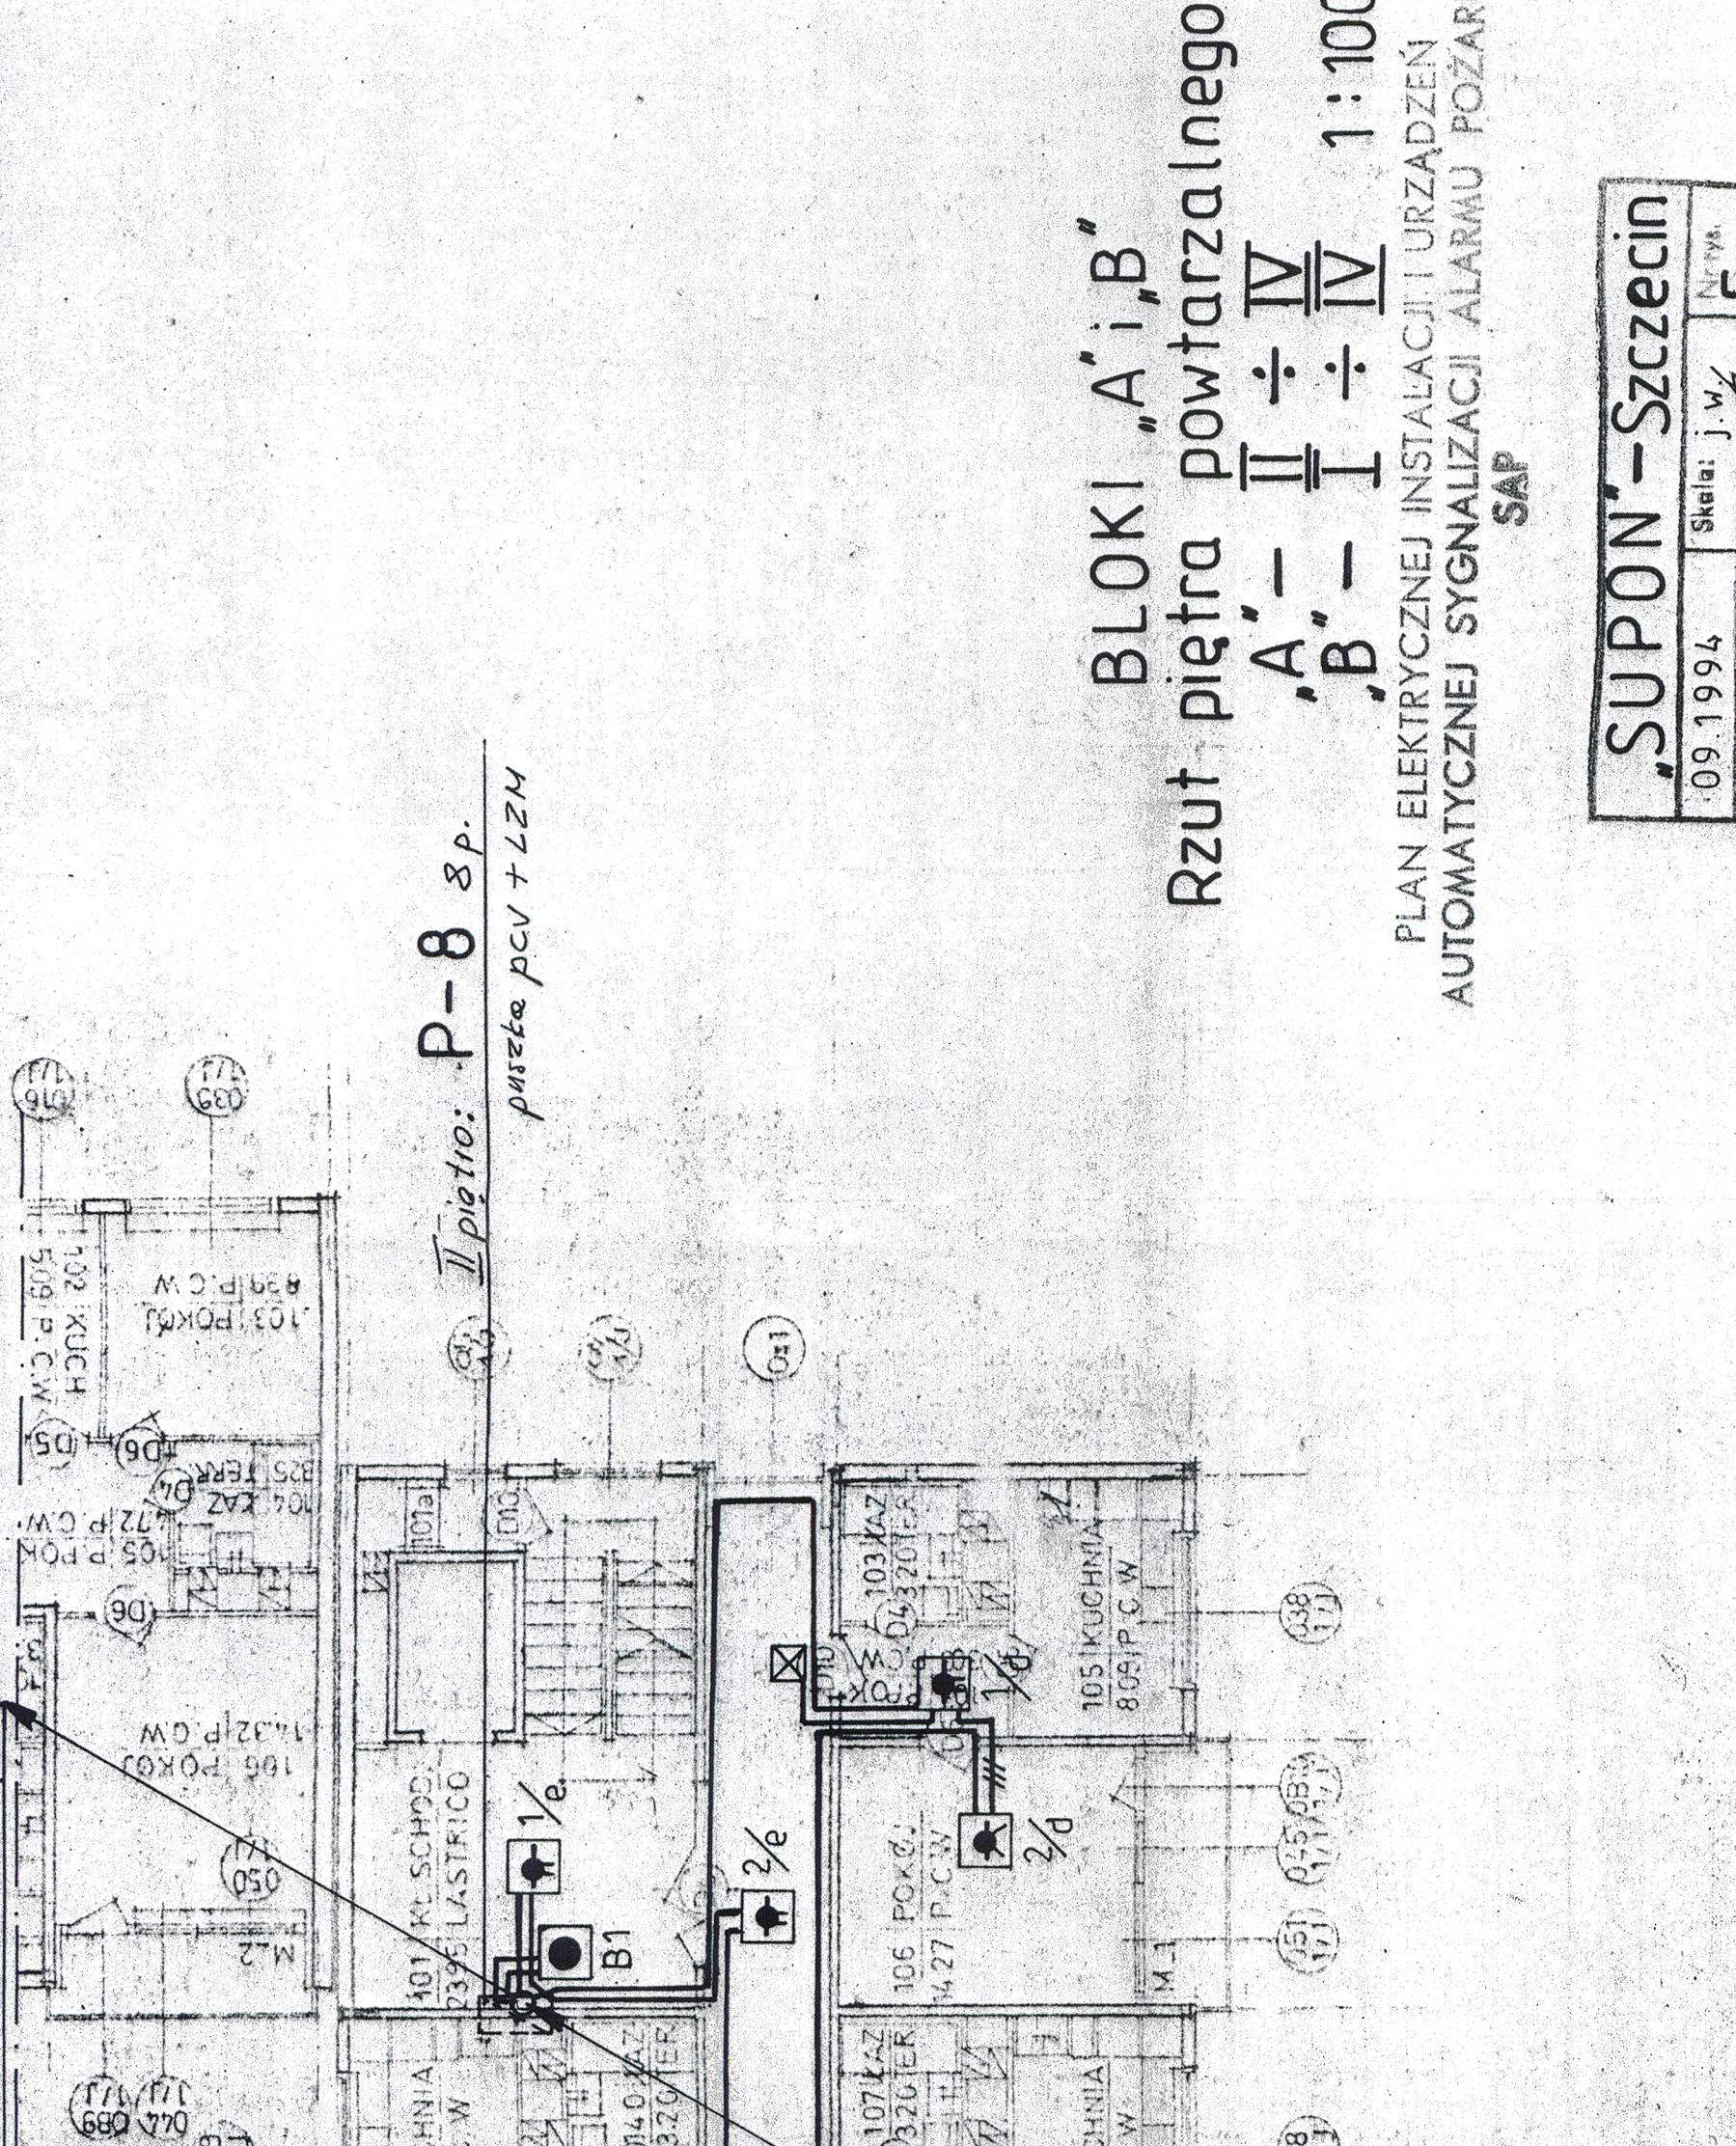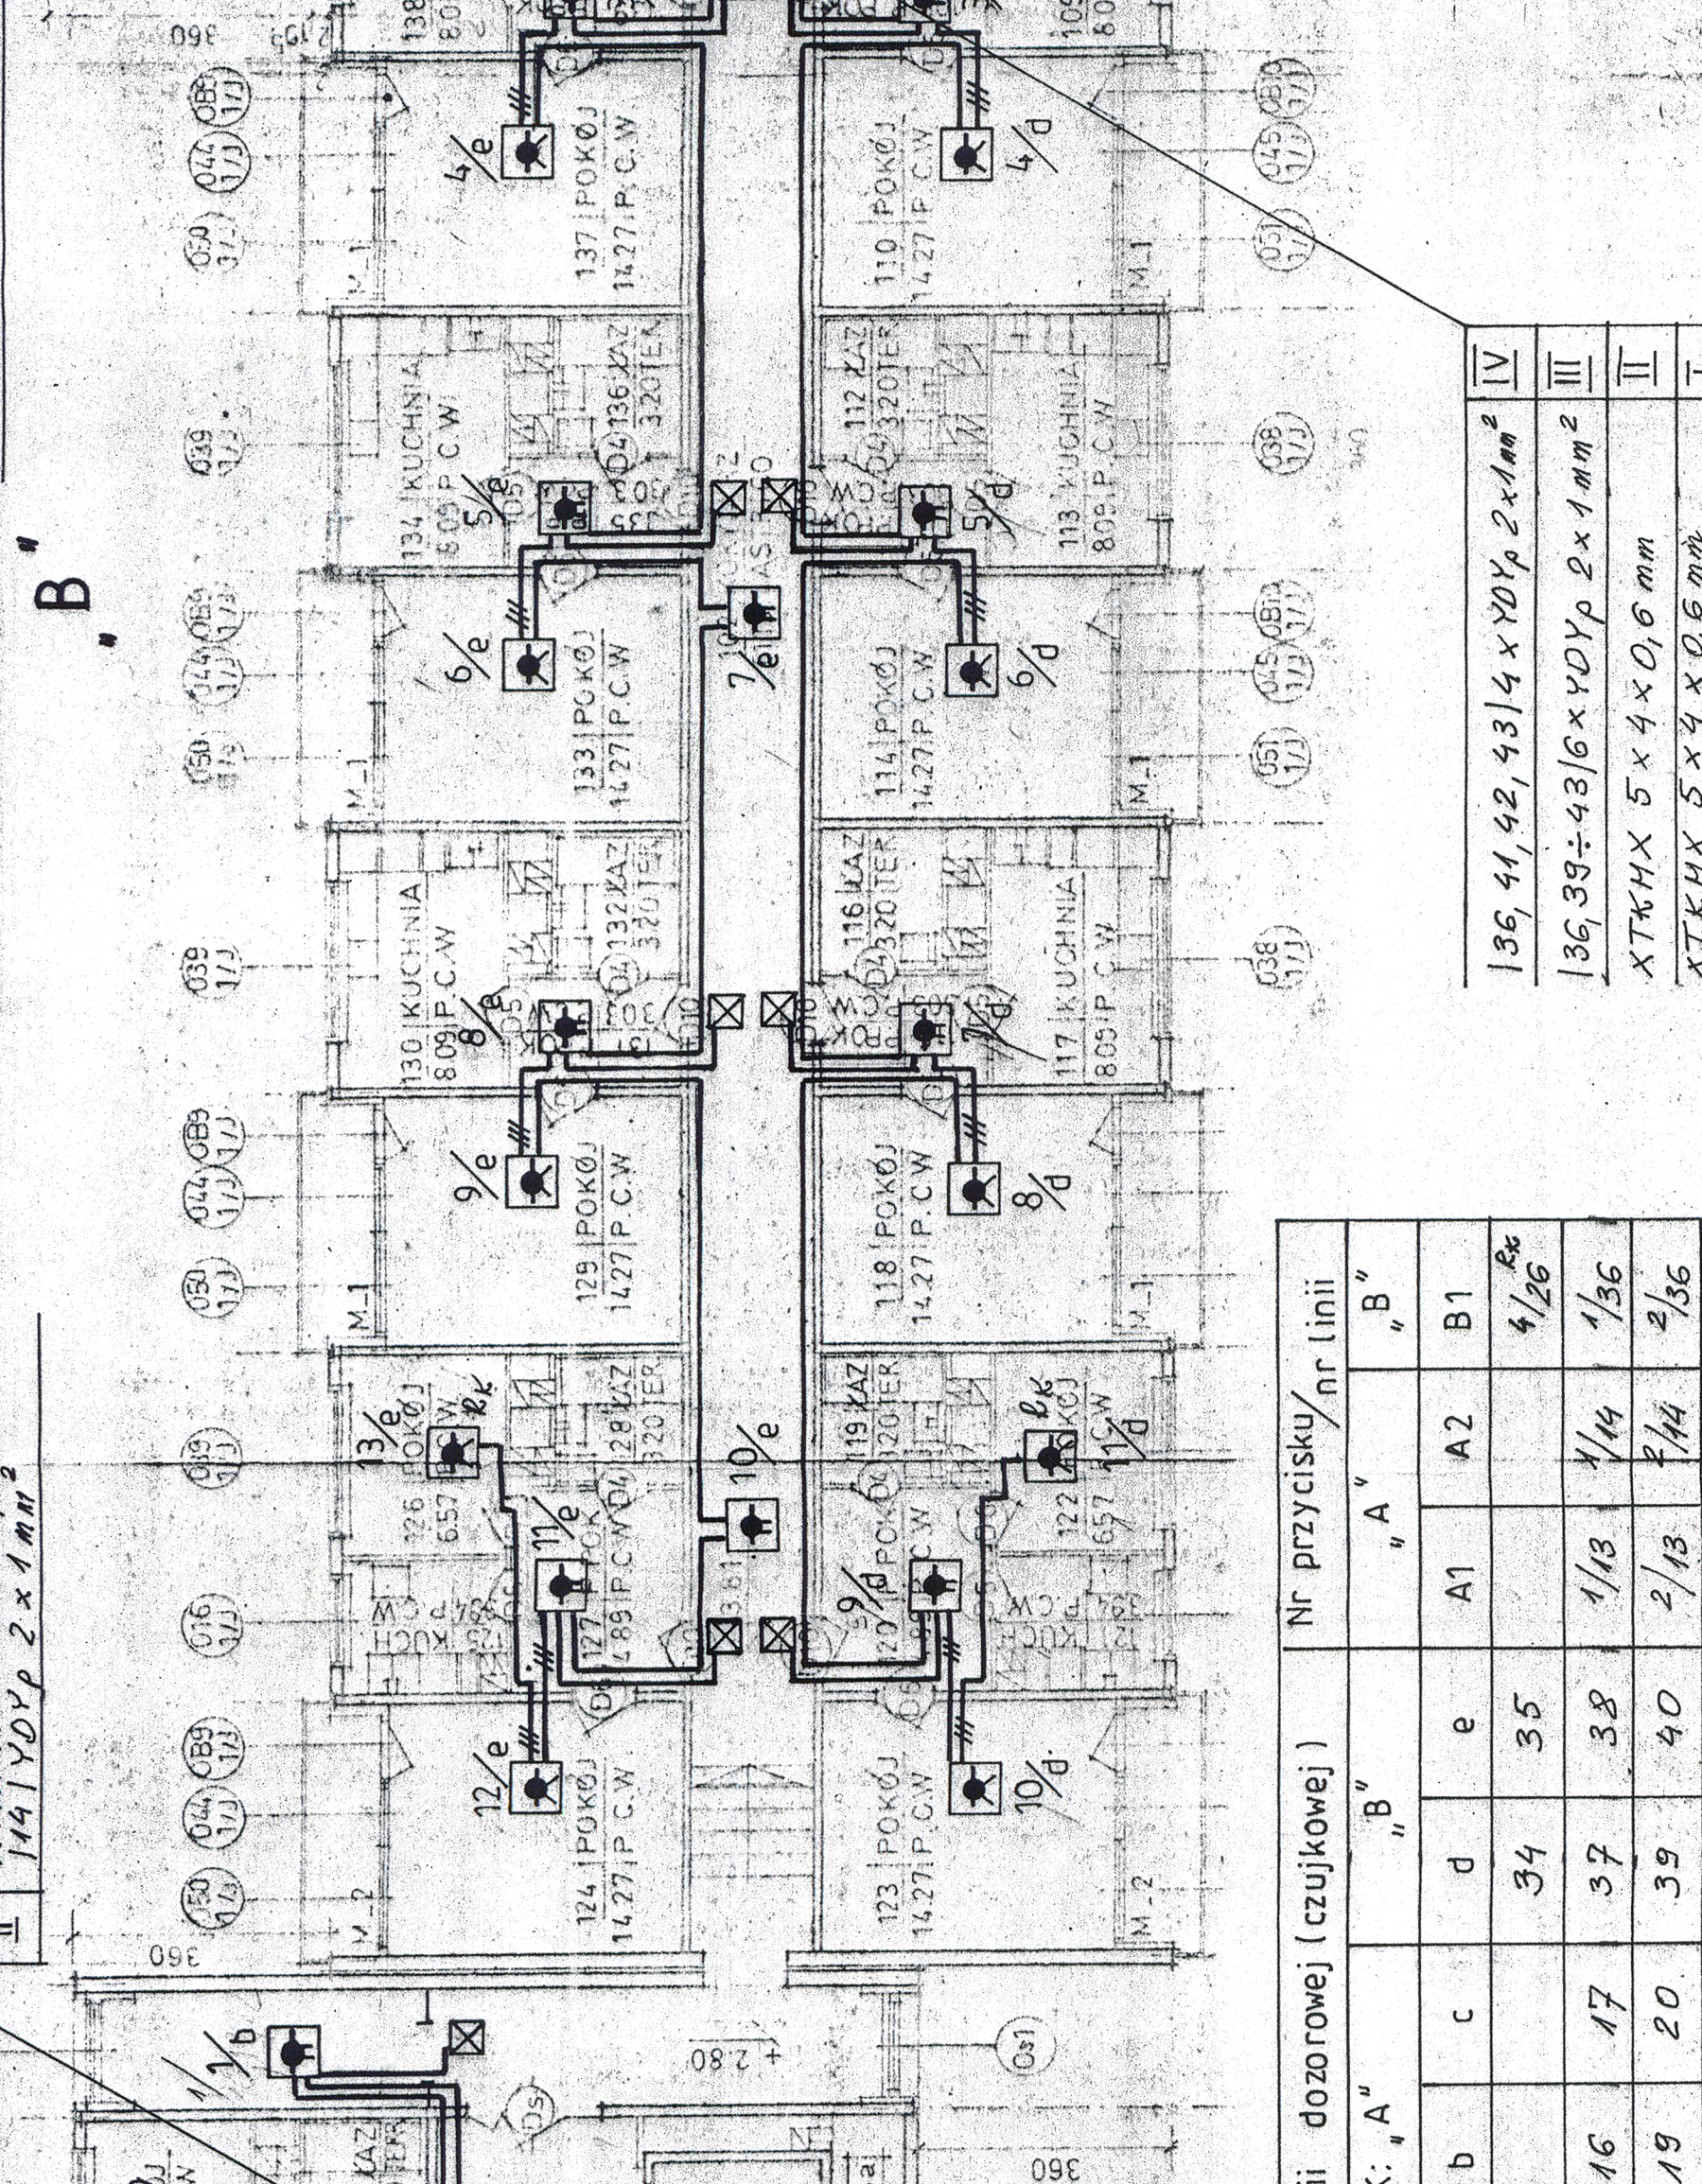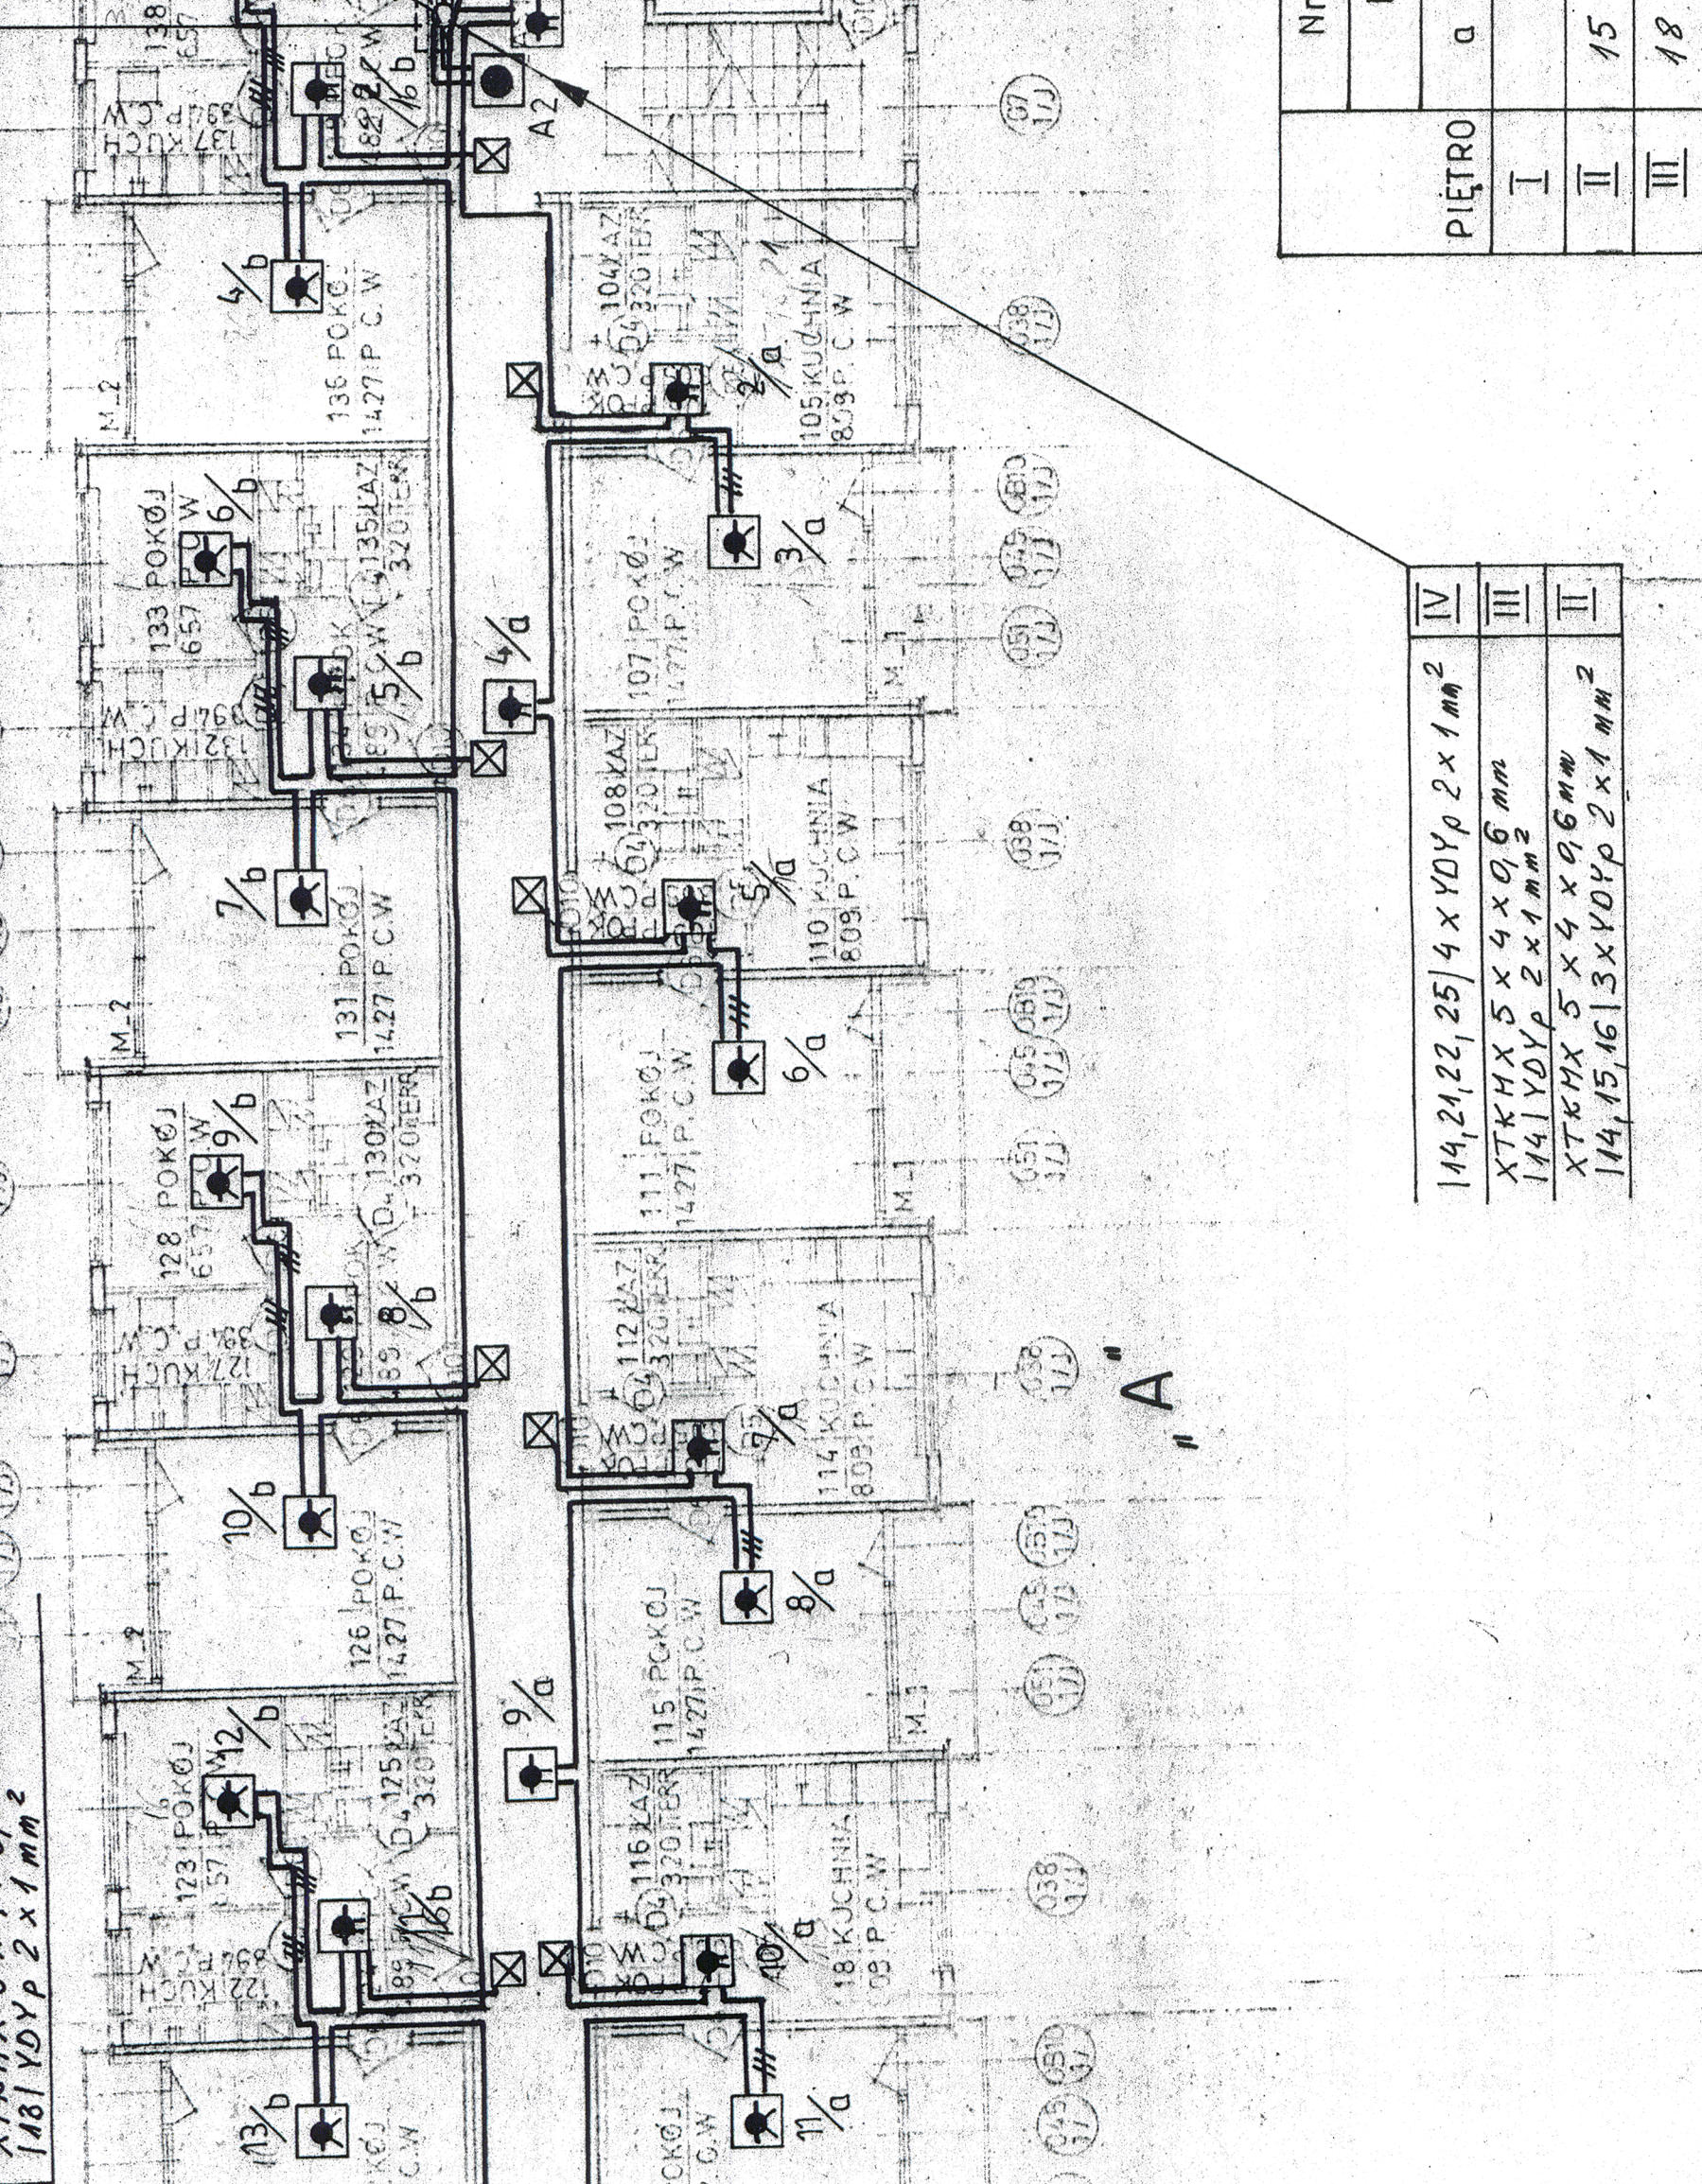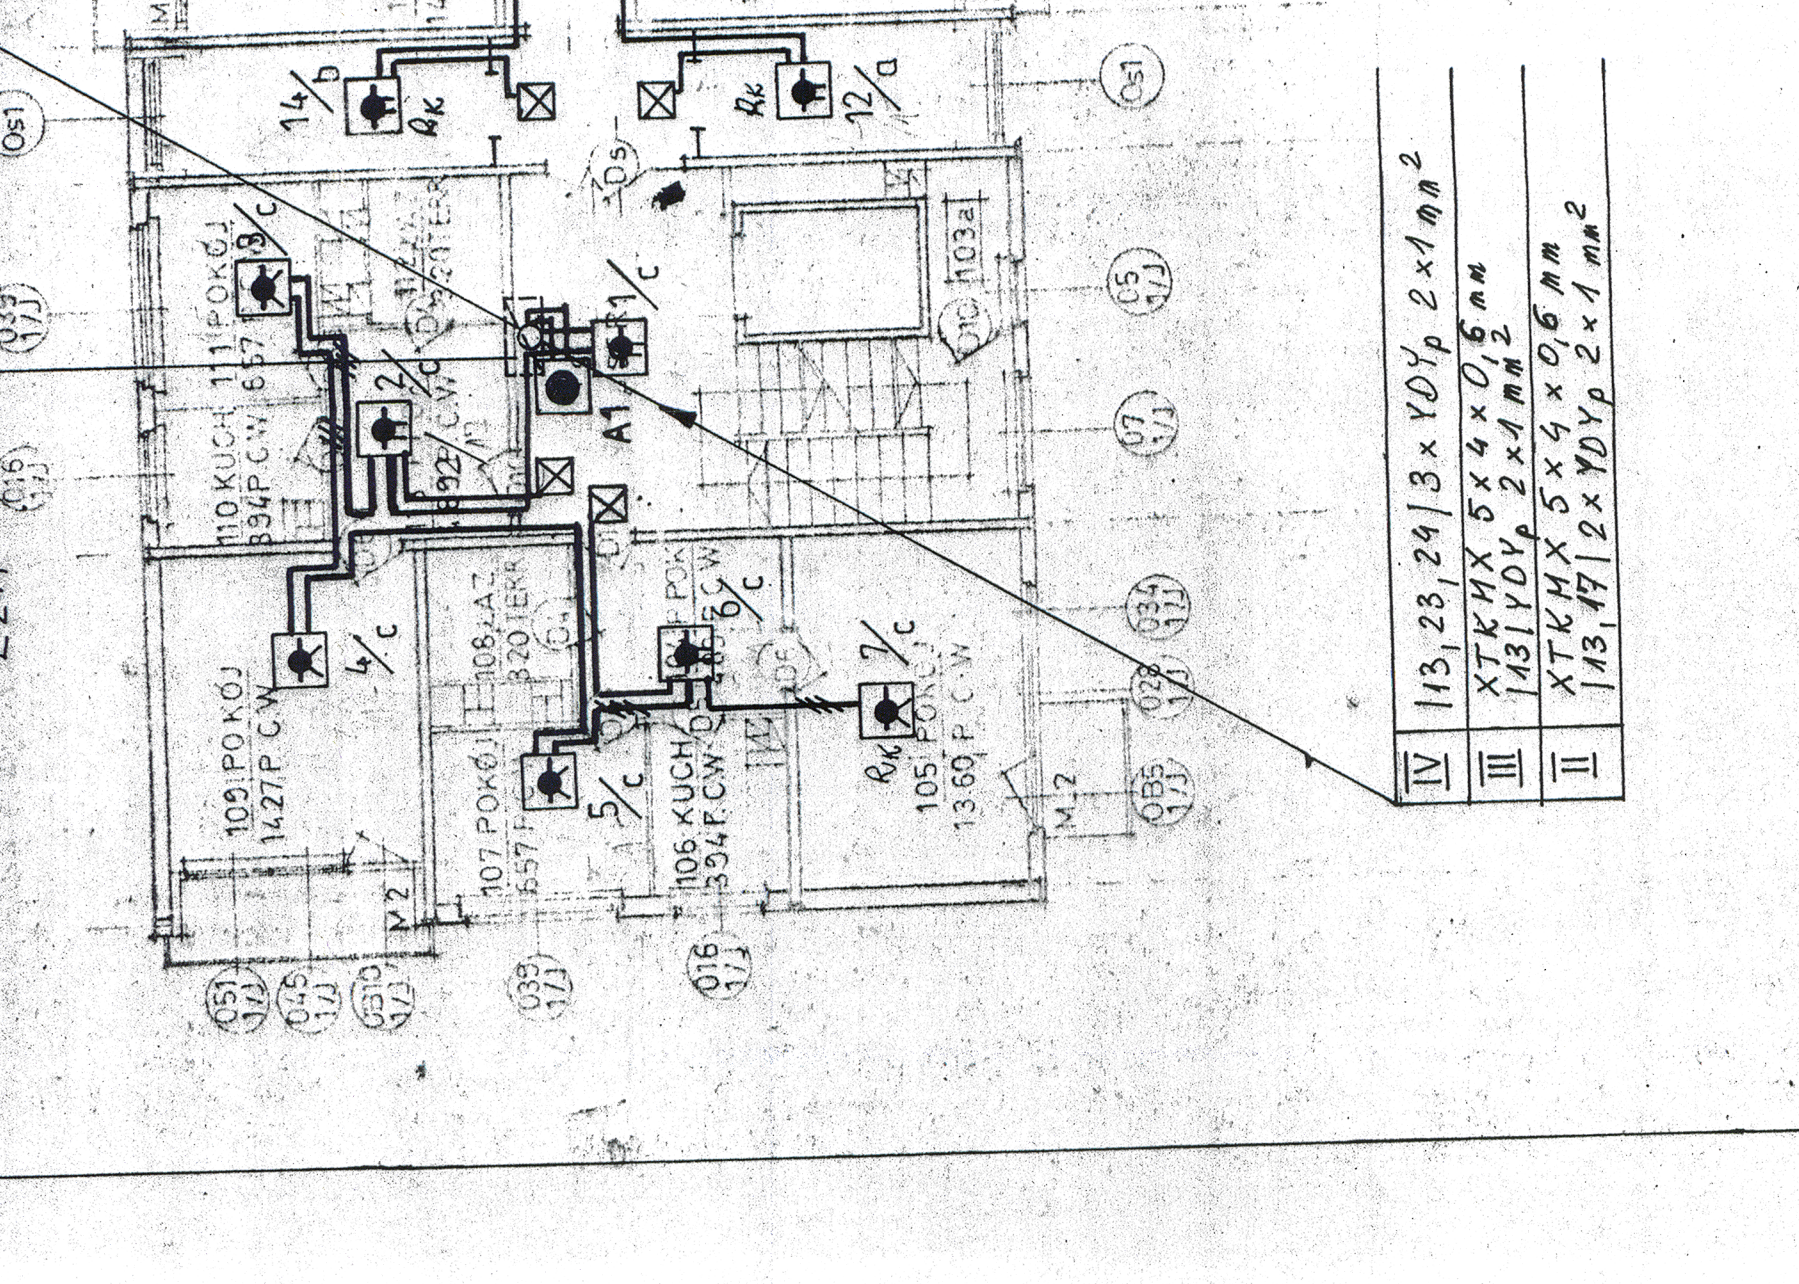

BLOKI „A i B”
Rzut piętra powtarzalnego:
„A” - II ÷ IV
„B” - I ÷ IV

PLAN ELEKTRYCZNEJ INSTALACJI I URZĄDZEN
AUTOMATYCZNEJ SYGNALIZACJI ALARMU POŻARU
SAP

„SUPON”-Szczecin	
09.1994	Skala: j.w.
Projektant:	Podpis:
nr. 85/94/85	

IV	113,23,24/3xYDYp 2x1mm ²
III	XTKH 5x4x0,6mm 143/YDYp 2x1mm ²
II	XTKH 5x4x0,6mm 143,17/2xYDYp 2x1mm ²

IV	114,21,22,25/4xYDYp 2x1mm ²
III	XTKH 5x4x0,6mm 144/YDYp 2x1mm ²
II	XTKH 5x4x0,6mm 144,15,16/2xYDYp 2x1mm ²

PIĘTRO	Nr linii dozоровej (czujkowej)				Nr przycisku/nr linii	
	BLOK: „A”		„B”		„A”	„B”
	a	b	c	d	A1	B1
I				34	e	4/26
II	15	16	17	37	38	1/36
III	18	19	20	39	40	2/36
IV	21	22	23	41	42	3/36

07111 DIETRA 1:100