


IV	170 YDYp 2 x 1 mm ²
III	158, 67, 70 3 x YDYp 2 x 1 mm ²
II	158, 64, 67, 70 4 x YDYp 2 x 1 mm ²
I	XTKHX 5 x 4 x 0,6 mm

IV	169 YDYp 2 x 1 mm ²
III	157, 66, 69 3 x YDYp 2 x 1 mm ²
II	157, 63, 66, 69 4 x YDYp 2 x 1 mm ²
I	XTKHX 5 x 4 x 0,6 mm

IV	168 YDYp 2 x 1 mm ²
III	156, 65, 68 3 x YDYp 2 x 1 mm ²
II	156, 62, 65, 68 4 x YDYp 2 x 1 mm ²
I	XTKHX 5 x 4 x 0,6 mm

IV	168 YDYp 2 x 1 mm ²
III	156, 65, 68 3 x YDYp 2 x 1 mm ²
II	156, 62, 65, 68 4 x YDYp 2 x 1 mm ²
I	XTKHX 5 x 4 x 0,6 mm

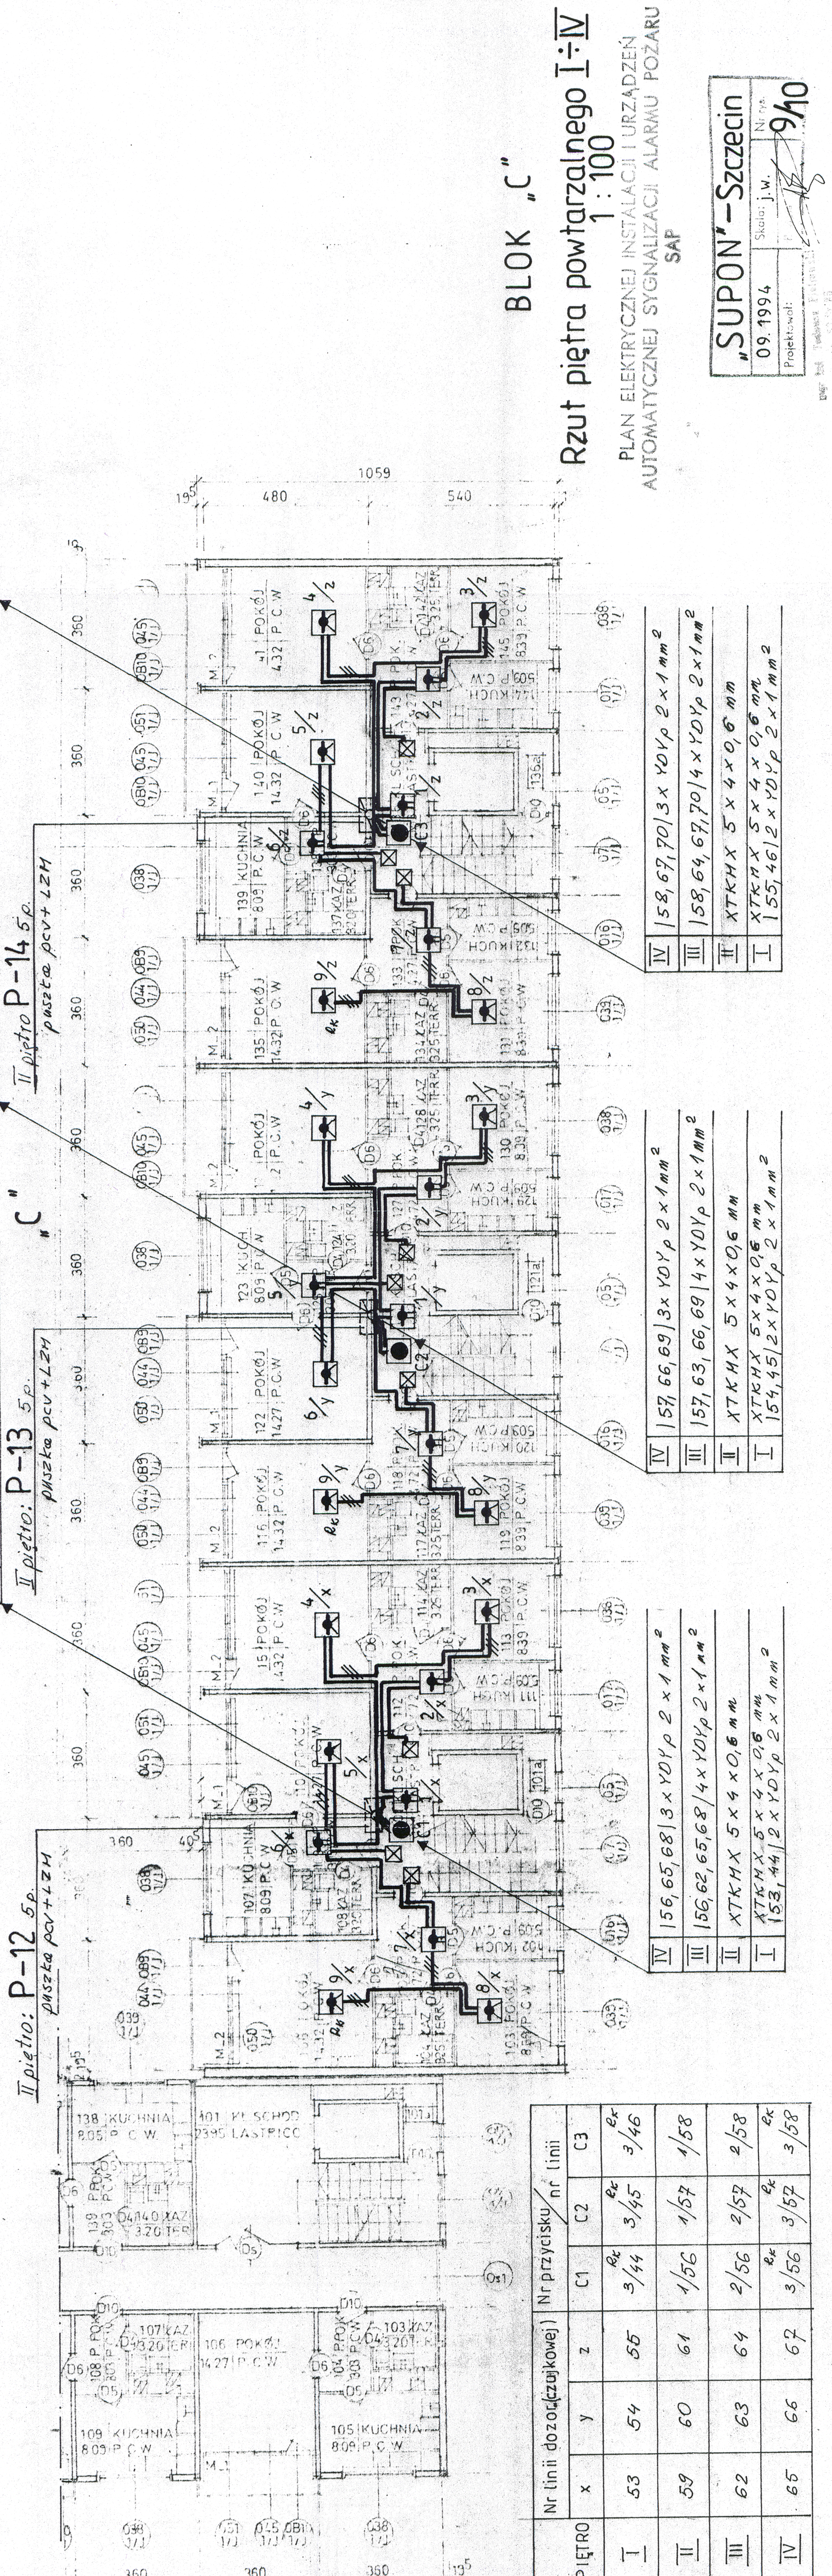

BLOCK "C"

Rzut piętra powtarzalnego I-IV

1:100

PLAN ELEKTRYCZNEJ INSTALACJI I URZĄDZEŃ
AUTOMATYCZNEJ SYGNALIZACJI ALARMU POŻARU
SAP

"SUPON"-Szczecin

Skala: j.w. Nr rva. 9/10

Projektował: [Signature]

PIĘTRO	Nr linii dozoru (czujkowej)			Nr przycisku / nr linii		
	x	y	z	C1	C2	C3
I	53	54	55	3/44	3/45	3/46
II	59	60	61	1/56	1/57	1/58
III	62	63	64	2/56	2/57	2/58
IV	65	66	67	3/56	3/57	3/58